

LPCB

This is to certify

VENTCROFT LIMITED

Faraday Road, Astmoor Industrial Estate, Runcom WA7 1PE

is authorised to use the LPCB mark in association with the product(s) listed in this certificate and appendix.

NoBurn XP

(refer to attached appendix for details)

has complied with the requirements of the following:

BS 6387: 1994 – Performance requirements for cables required to maintain circuit integrity under fire conditions.

and achieved:

<0.5%HCl when tested in accordance with BS EN 50267-2-1: 1999 – Method of test for Gases evolved during combustion of electric cables.

>50% light transmittance when tested in accordance with BS EN 61034-2: 2005 – Measurement of smoke density of cables burning under defined conditions.

Class PH120 when tested in accordance with BS EN 50200: 2006 - Method of test for resistance to fire of unprotected small cables for use in emergency circuits.


Certificate No. 682c

Issue No. 01


Date of Issue 10 April 2013

This certificate is valid until withdrawn by LPCB.
To check the validity and the authenticity of this certificate please visit our website www.RedBookLive.com or contact us.

Signed on behalf of LPCB



Name: D HOARE

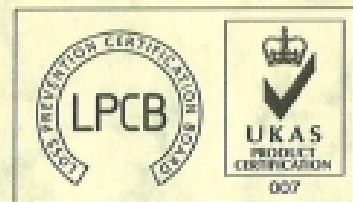

LPCB is part of BRE Global Ltd., Garston, Watford WD25 9XX. Tel +44 (0)1923 864100
Fax +44 (0)1923 864603 www.RedBookLive.com

This certificate remains the property of BRE Global Ltd and is issued subject to terms and conditions and is maintained and held in force through regular surveillance activities.

COPY
10/04/2013

Loss Prevention Certification Board

LPCB

APPENDIX TO CERTIFICATE NO. 682c

VENTCROFT LIMITED

Products

LPCB Ref. No.

NoBurn XP

682c/01

Nominal csa of conductor (mm ²)	Core construction (excluding drain wire)	BS 6387	BS EN 50267-2-1	BS EN 61034-2	BS EN 50200 Annex C	BS EN 50200
0.5 ⁽¹⁾	2, 3 & 4	C, W, Z	<0.5% HCI	>60%	30min ⁽²⁾	Class PH120
0.75 ⁽¹⁾	2, 3 & 4	C, W, Z	<0.5% HCI	>60%	30min ⁽²⁾	Class PH120
1.0 ⁽¹⁾	2, 3 & 4	C, W, Z	<0.5% HCI	>60%	30min ⁽²⁾	Class PH120
1.5 ⁽¹⁾	2, 3 & 4	C, W, Z	<0.5% HCI	>60%	30min ⁽²⁾	Class PH120
2.5 ⁽¹⁾	2, 3 & 4	C, W, Z	<0.5% HCI	>60%	30min ⁽²⁾	Class PH120
4.0 ⁽²⁾	2, 3 & 4	C, W, Z	<0.5% HCI	>60%	30min ⁽²⁾	Class PH120

Uo/U 300/500V

Note 1: Solid conductor only.


Note 2: Stranded conductor only.

Note 3: The duration of 30min when tested in accordance with BS EN 50200: 2006 Annex E is achieved by 15min for the fire and impact phase and an additional 15min for the fire, impact and water phase.

Cross-Listed products and alternative branding are detailed on page 3.

This certificate is valid until withdrawn by LPCB.
To check the validity and the authenticity of this certificate please visit our website www.RedBookLive.com or contact us.

Signed on behalf of LPCB



Name: D HOARE

Page 2 of 3

Date of Issue 10 April 2013

Issue No. 01

LPCB is part of BRE Global Ltd., Garston, Watford WD25 9XX. Tel +44 (0)1923 664100

Fax +44 (0)1923 664603 www.RedBookLive.com

This certificate remains the property of BRE Global Ltd and is issued subject to terms and conditions and is maintained and held in force through regular surveillance activities.